



## NOTES:

- 1. ITEM 655.02 FRAME & GRATE- FRAME 2'-4 15/16 " X 3'-1 1/2" GRATE 2'-3 11/16 " X 3'-0 1/2" RECTANGULAR FRAME & GRATE ASSEMBLY TYPE ND. 11, SEE N.Y.S.D.D.T. STANDARD SHEETS SHEETS 655-4R1, 655-5R1, 655-6R1 AND 655-3. PAYMENT AREA = 7.2 SQ. FEET
- 2. REINFORCEMENT SHALL HAVE A COVER OF 2" UNLESS OTHERWISE SHOWN. THE COST OF ALL BAR REINFORCEMENT SHALL BE INCLUDED IN THE PRICE BID FOR DROP INLETS.
- 3. THE INTERIOR AND EXTERIOR OF ALL DROP INLETS TO BE COATED WITH TWO COATS OF KOPPERS SUPER SERVICE BLACK OR APPROVED EQUAL.
- 4. CLASS "A" CONCRETE IS TO BE USED. WALL THICKNESS SHALL BE 6" IF REINFORCED, 8" IF UNREINFORCED. ALL PIPE CONNECTIONS SHALL BE MADE WITH 100% MORTAR.
- 5. CLASS "A" CONCRETE BENCHES SHALL BE CAST-IN-PLACE ON ALL STORM DROP INLETS REGARDLESS OF PIPE DIAMETER. COST TO BE INCLUDED IN DROP INLET ITEM.
- 6. INSIDE DIMENSIONS SHALL BE 2'-0" x 2'-8".
- 7. REFER TO FRAME & GRATE ANCHOR DETAIL.

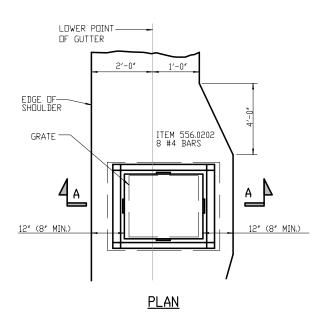

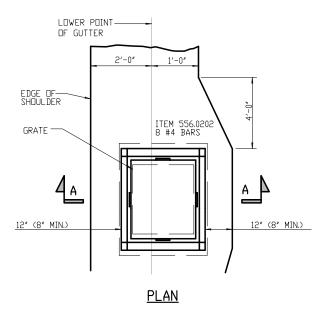

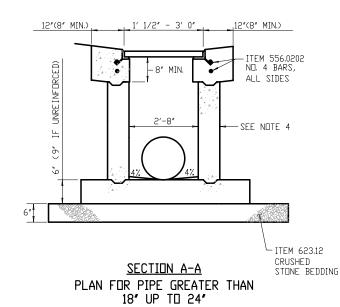

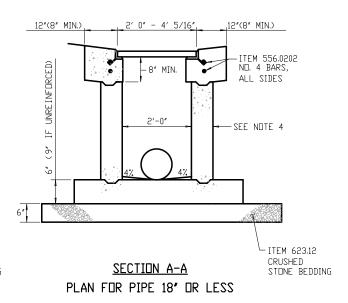

DROP INLET TYPE "S" CAST-IN-PLACE WITH GUTTER

1/7/03